


Model Number	Nominal Size (Inches) W x H x D	Actual Size (Inches) W x H x D	Rated Air Flow (CFM)	Initial Resistance (In. W.G.)	Media Area (Square Feet)
PAF11-STD4	12 x 24 x 4	11-3/8 x 23-3/8 x 3-3/4	1000	0.25	12.4
PAF11-STD4	16 x 20 x 4	15-1/2 x 19-1/2 x 3-3/4	1200	0.25	14.5
PAF11-STD4	16 x 25 x 4	15-1/2 x 24-3/4 x 3-3/4	1400	0.25	18.3
PAF11-STD4	18 x 24 x 4	17-1/2 x 23-1/2 x 3-3/4	1500	0.25	19.9
PAF11-STD4	20 x 20 x 4	19-1/2 x 19-1/2 x 3-3/4	1400	0.25	18.7
PAF11-STD4	20 x 24 x 4	19-3/8 x 23-3/8 x 3-3/4	1670	0.25	22.4
PAF11-STD4	20 x 25 x 4	19-1/2 x 24-1/2 x 3-3/4	1750	0.25	23.5
PAF11-STD4	24 x 24 x 4	23-3/8 x 23-3/8 x 3-3/4	2000	0.25	27.4
PAF11-STD4	25 x 29 x 4	24-1/2 x 28-1/2 x 3-3/4	2500	0.25	36.5

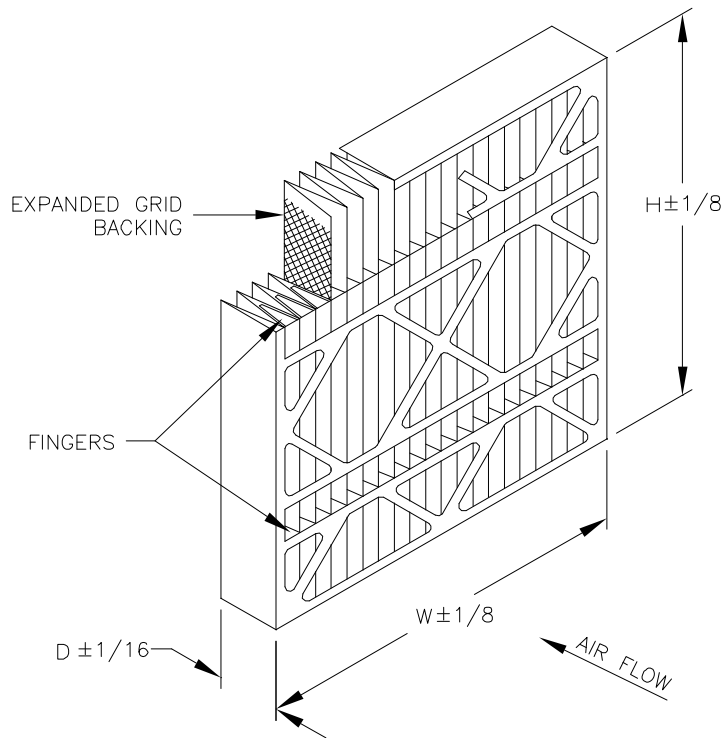

\* Reversed Pleat Direction

#### STANDARD CONSTRUCTION

1. White Electrostatic Synthetic Media
2. 11 Pleats Per Foot
3. Expanded Metal Pleat Supports
4. Moisture Resistant Beverage Board Frame
5. Double Wall Frame
6. (2) Rows of Fingers on Air Entering Side

#### NOTES

1. MERV 11 per ASHRAE 52.2-2012  
Tested at 492 FPM on 24x24x4
2. Final Resistance: 1.0" W.G.
3. Rated Velocity: 500 FPM
4. Classified per UL Standard 900 for Flammability
5. Maximum Operating Temperature: 200 deg. F

**Purolator**  
 100 River Ridge Circle  
 Jeffersonville, IN 47130  
 P: 866-925-2247  
 F: 866-601-1809  
 www.purolatorair.com

CONTACT FACTORY TO  
 VERIFY REVISION LEVEL

#### TOLERANCES UNLESS OTHERWISE SPECIFIED

FRACTIONAL -  
 DECIMAL -  
 ANGLES -

ALL DIMENSIONS IN INCHES

DRAWING NAME

PAF 11 (4" DEPTH)

APPROVED BY

*K. O. Quinn*

SPECIFICATION NO.

MKT-P-00160

PAGE

1 OF 1

SCALE

NONE

DWG. SIZE

A

REVISION

A

REVISION DATE

08-11-14

CONFIDENTIAL - DO NOT COPY. THIS MATERIAL IS TRADE SECRET AND PROPRIETARY BEING EXCLUSIVELY OWNED BY CLC AIR. THE EXPRESSION OF THE INFORMATION CONTAINED HEREIN IS PROTECTED UNDER FEDERAL COPYRIGHT LAWS AND ALL COPYING IS PROHIBITED AND MAY BE SUBJECT TO CRIMINAL PENALTIES.